


# How to connect the battery cabinet inspection line

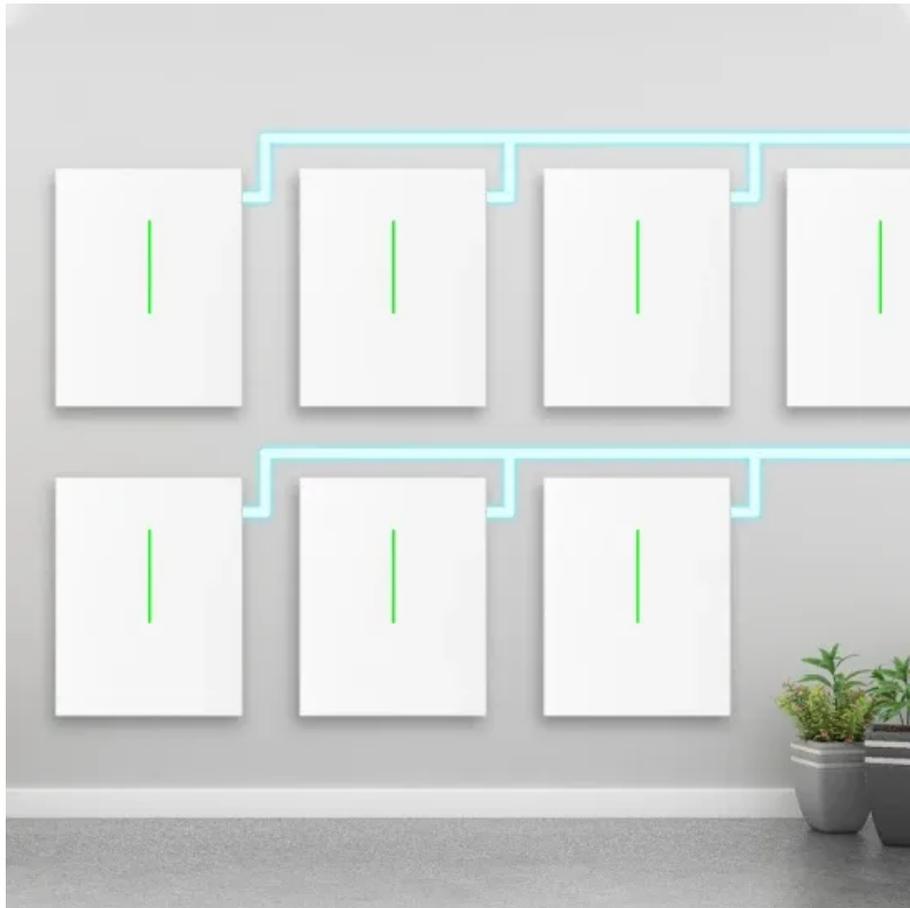

## Overview

---

Connect the battery cable accessory to one end of the battery port on the rear panel of the UPS and connect the other end to any battery port on the rear panel of the EBC. Make sure they are in parallel. st an inspection by the carrier and file a concealed damage claim. When AC power fails, the. ZincFive batteries. Refer to ZincFive's BC Series UPS Battery Cabinet Service Manual for information related to servicing and. **IMPORTANT:** Before installing, connecting to supply or operating your Vertiv™ Liebert® ITA2 Battery Cabinet, please review the Safety and Regulatory Statements sheet.

## How to connect the battery cabinet inspection line



### LIEBERT ITA2 Quick-Start BATTERY Guide CABINET

It connects the battery strings in parallel to extend the backup time of the UPS. The factory-provided communication cable has an RJ-45 terminal on each end for communicating with the battery cabinets.

## UPS Battery Cabinets

BC 2 300X/500 Battery Conditioning (pgs. 35-36) in ZincFive's BC 2 Series UPS Battery Cabinet Service Manual for the recommended UPS LVCO and expected power levels in the customer application.



### BC58 Battery Cabinet Installation, Operation, & Maintenance ...

Battery cabinets that are not supplied with an incorporated DC output disconnect device must have an appropriate disconnect device provided external to the cabinet.

## SolaHD S4K-D External Battery Cabinet QIG Manual PDF

Connect the battery cable accessory to one end of the battery port on the rear panel of the UPS and connect the other end to any battery port on the rear panel of the EBC.



## Eaton Samsung Gen 3 Battery Cabinet Installation and Operation ...

Control wiring can be routed through the sides of the battery cabinets in side by side configurations or through the top of the battery cabinets using conduit in standalone configurations.


## Integrity Max Battery Cabinet User Manual

Before performing any work on the battery cabinet, please read this user manual carefully and follow the proper installation, operation, and maintenance instructions.



## Position and Interconnect the Battery Cabinets

NOTE: This procedure describes how to

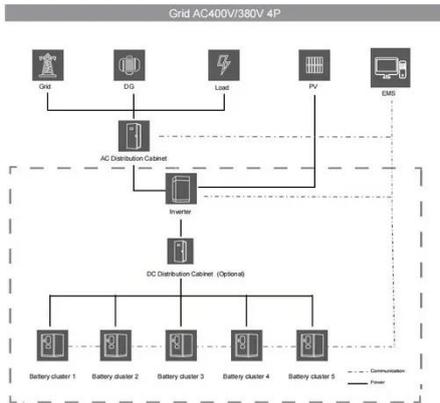

position and interconnect several battery cabinets. If your system only has one battery cabinet, you only need to follow step 2 and step 3.

## BATTERY INSPECTION CHECKLIST

Note: Battery should be Replaced if ~  
 Point 2,4 & 7: Badly damage ~ Point 16:  
 < 6,5 VDC or < 300A Battery should be  
 Recharged if ~ All Visual Inspection OK  
 ~ Point 16 in Range: 6,5 VDC - 9,6 VDC



## Vertiv™ Liebert® ITA2 Battery Cabinet

Connect a battery-to-battery cable to Connector B on the first cabinet in the previous string, and to Connector A on first cabinet in the additional string. Connect the second string in additional battery ...

## Contact Us

For catalog requests, pricing, or partnerships, please visit:

<https://kidsandparents.pl>

